



HILLSBOROUGH COUNTY FIRE MARSHAL'S OFFICE

3210 South 78th Street Tampa, Florida 33619
813-744-5541



Structures with light-frame truss roofs shall be marked with the letter "R"



Structures with light-frame truss floor system shall be marked with the letter "F"




Structures with light-frame truss floor and roof system shall be marked with the letters "RF"

- Symbols must be all weather and contrasting background
- Maltese Cross shall measure 8" horizontally and 8" vertically
- Maltese Cross shall be bright red reflective in color
- Maltese Cross shall be within 24" of and to the left of the main entry
- Maltese Cross shall be not less than 4 feet above grade
- Maltese Cross shall be not more than 6 feet above grade
- It may be determined that additional signs may be needed as determined by the Fire Marshal

FIREFIGHTER SAFETY WARNING SIGNS

for Structures with Light-Frame Truss-Type Construction
in Accordance with the Florida Administrative Code 69A-3.012

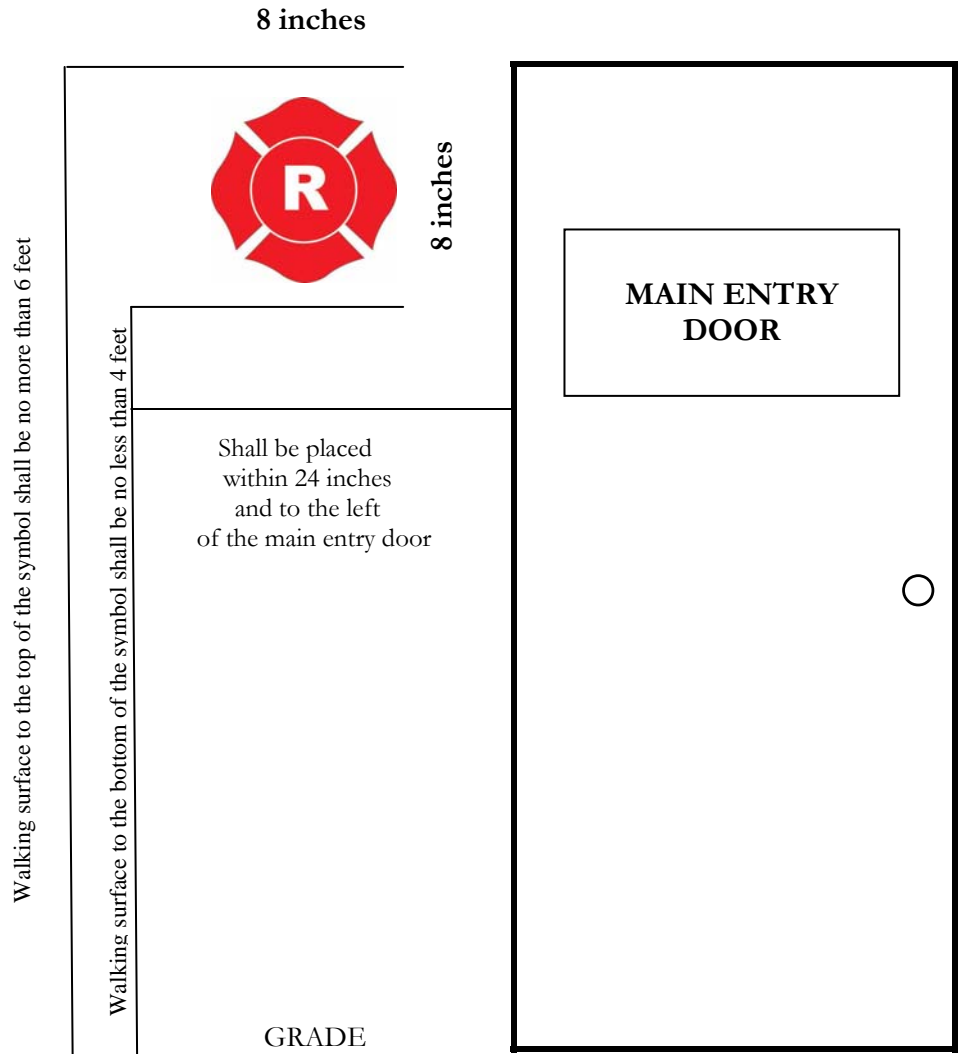

NOTE: The complete rules may be found at the State Fire Marshal's web site
http://www.myfloridacfo.com/sfm/SFM_Rules_FAC.htm